


**ARAL SALT ROOM PLAN**

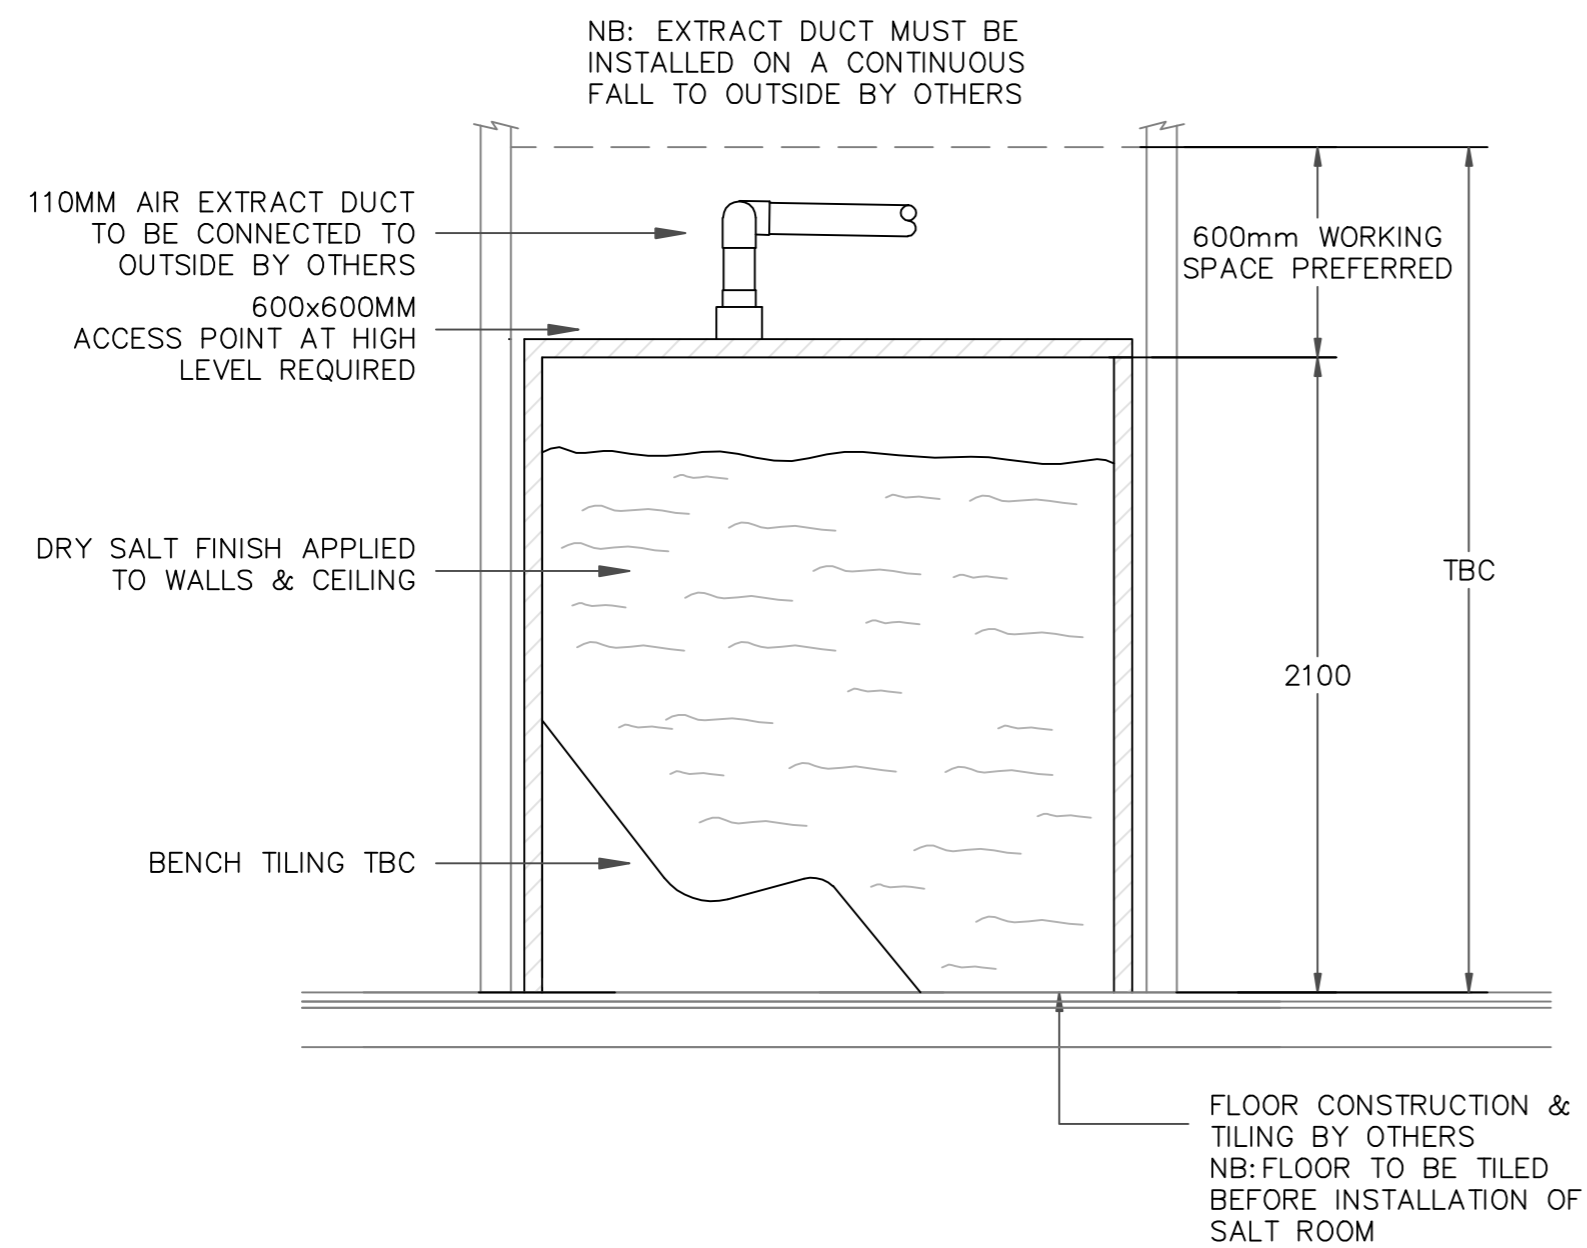

**ARAL SALT ROOM SECTION**

**ARAL SALT ROOM SERVICE REQUIREMENTS**

SALT ROOM TO BE FITTED ONTO A FLOOR WHICH IS WATER PROOF SCREEDED


SALT ROOM FLOOR TO BE TILED BY OTHERS AFTER SALT ROOM HAS BEEN INSTALLED. GROUT TO BE EPOXY GROUT

110MM EXTRACT VENT AND MECHANICAL FAN IS SUPPLIED WITH THE SALT ROOM, 110MM PLASTIC EXTRACT DUCT IS TO BE SUPPLIED BY OTHERS ABOVE SALT ROOM

22MM LPHW SUPPLY 25-45°C VARIABLE WITH A 'STAT AND BYPASS BY OTHERS AT 1.5 TO 2 LITRES PER MINUTE FLOW AND RETURN REQUIRED TO A STOP TAP ABOVE SALT ROOM FOR HEATED LOUNGERS. APPROXIMATELY 1.5kW PER LOUNGER.

1 NO 25 AMP SINGLE PHASE SUPPLIES REQUIRED TO AN ISOLATOR BY OTHERS. ISOLATORS TO BE WITHIN 1 METRE OF SALT ROOM CONTROL PANEL

PLEASE NOTE THAT SERVICE REQUIREMENTS ARE DEPENDANT UPON ROOM SIZE.

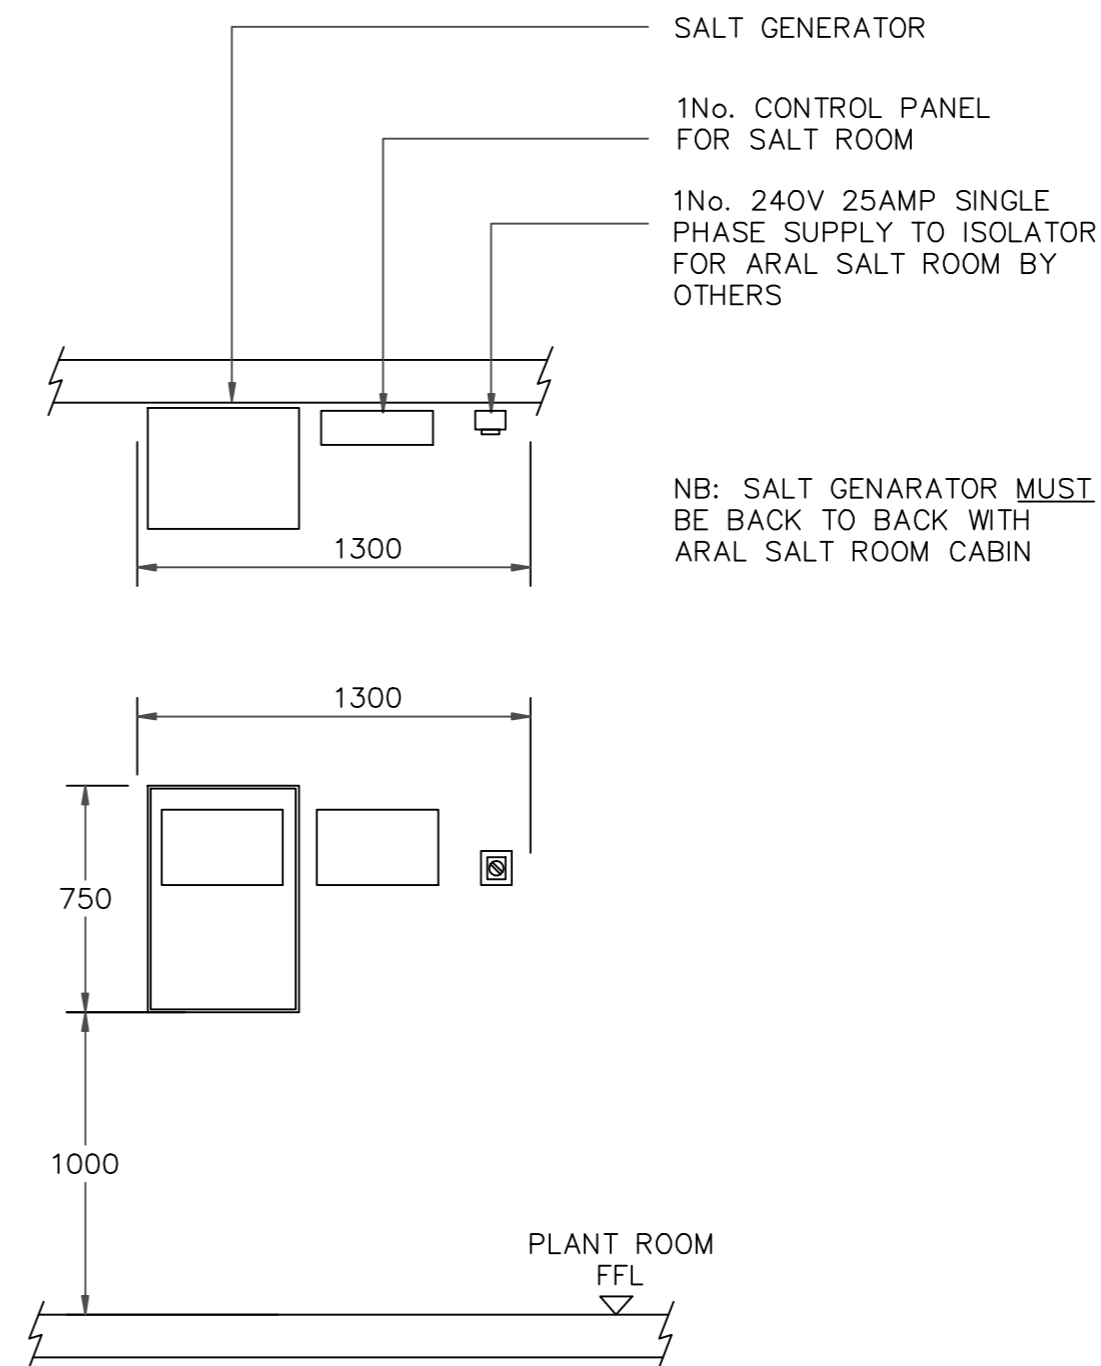


**ARAL SALT ROOM PLANT**

**NOTES:**

All dimensions must be checked on site and not scaled from this drawing.

This drawing is the copyright of Aachen Wellness Limited. and must not be copied, in part or in full, or the contents divulged to any third party without the written approval of Aachen Wellness Limited.

NB: A MINIMUM ALLOWANCE OF 600MM OF SEATING SPACE SHOULD BE ALLOWED FOR EACH PERSON

Rev	Date	Amendments	By
 <i>Aachen Wellness.</i>			
<b>Project Title</b>			
<b>STANDARD DRAWINGS</b>			
<b>Drawing Title</b>			
<b>ARAL SALT ROOM SPECIALIST</b>			
<b>Date</b>		<b>Scale</b>	
22.07.10		1:25@A2	
<b>Status</b>			<b>Drawn by</b>
FOR COMMENT			RL
<b>Drawing No.</b>			<b>Rev</b>
07			*