


TEPIDERIUM PLAN

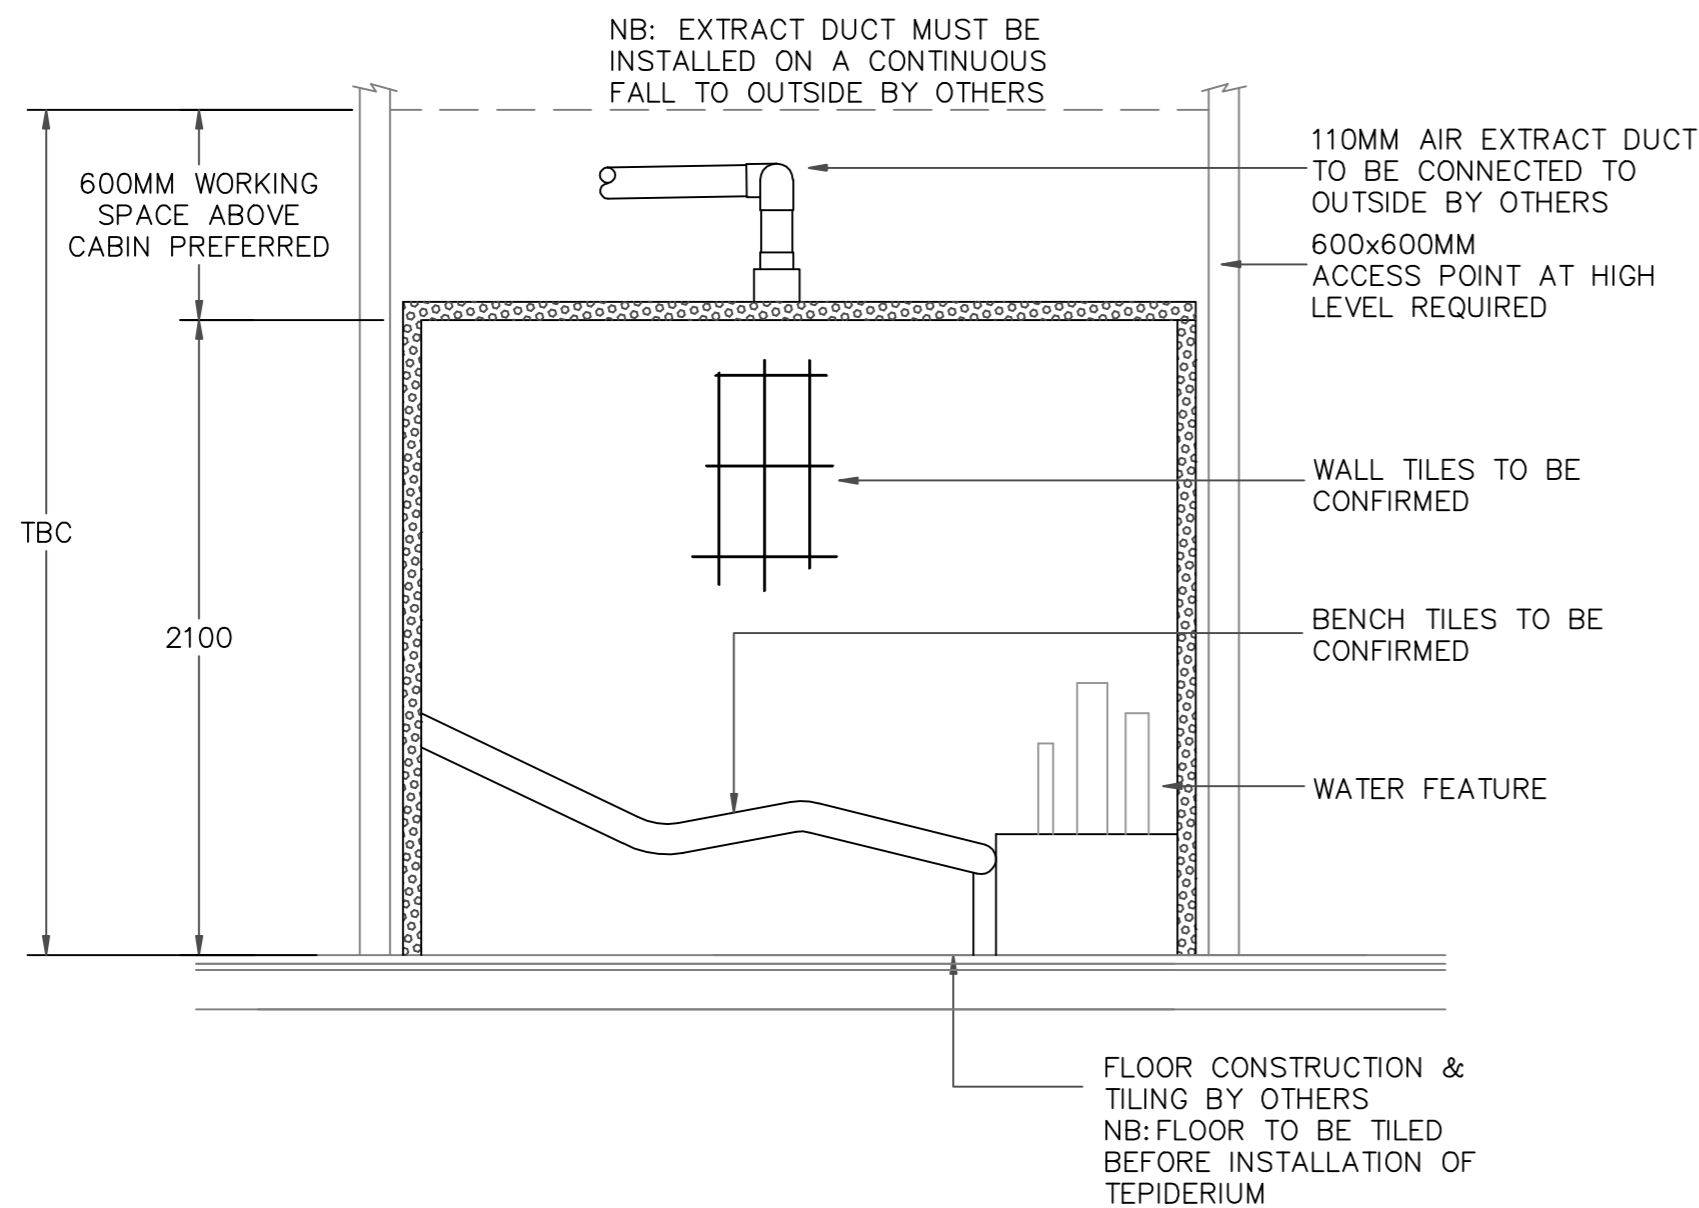

TEPIDERIUM SECTION

TEPIDERIUM SERVICE REQUIREMENTS

THE TEPIDERIUM CABIN SHOULD BE MOUNTED ON A FLOOR THAT IS MADE OF A MATERIAL THAT IS IMPERVIOUS TO MOISTURE. THE FLOOR NEEDS TO BE LEVEL ROUND THE PERIMETER.

TEPIDERIUM FLOOR TO BE TILED BY OTHERS BEFORE TEPIDERIUM INSTALLATION. GROUT TO BE EPOXY GROUT

110MM EXTRACT VENT AND MECHANICAL FAN IS SUPPLIED WITH THE TEPIDERIUM, 110MM PLASTIC EXTRACT DUCT IS TO BE SUPPLIED BY OTHERS ABOVE TEPIDERIUM

22MM LPHW SUPPLY 25-45°C VARIABLE WITH A 'STAT AND BYPASS BY OTHERS AT 3 TO 4 LITRES PER MINUTE FLOW AND RETURN REQUIRED TO A STOP TAP ABOVE TEPIDERIUM. APPROXIMATELY 3kW FOR AVERAGE SIZE ROOM PLUS 1.5kW PER LOUNGER.

T.V AERIAL TO BE PROVIDED BY OTHERS


TEPIDERIUM CONTROL PANEL TO BE MOUNTED IN PLANT ROOM.

3 PHASE NEUTRAL SUPPLY AT 25 AMPS PER PHASE SUPPLIED TO AN ISOLATOR BY OTHERS FOR TEPIDERIUM. ISOLATOR TO BE POSITIONED WITHIN 1 METRE OF CONTROL PANEL.

15MM COLD WATER SUPPLY (PRESSURE BETWEEN 1 - 5.8 BAR) REQUIRED TO A STOP TAP IN PLANT ROOM BY OTHERS.

TEMPERATURE - 80-95°C

PLEASE NOTE THAT SERVICE REQUIREMENTS ARE DEPENDANT UPON ROOM SIZE.

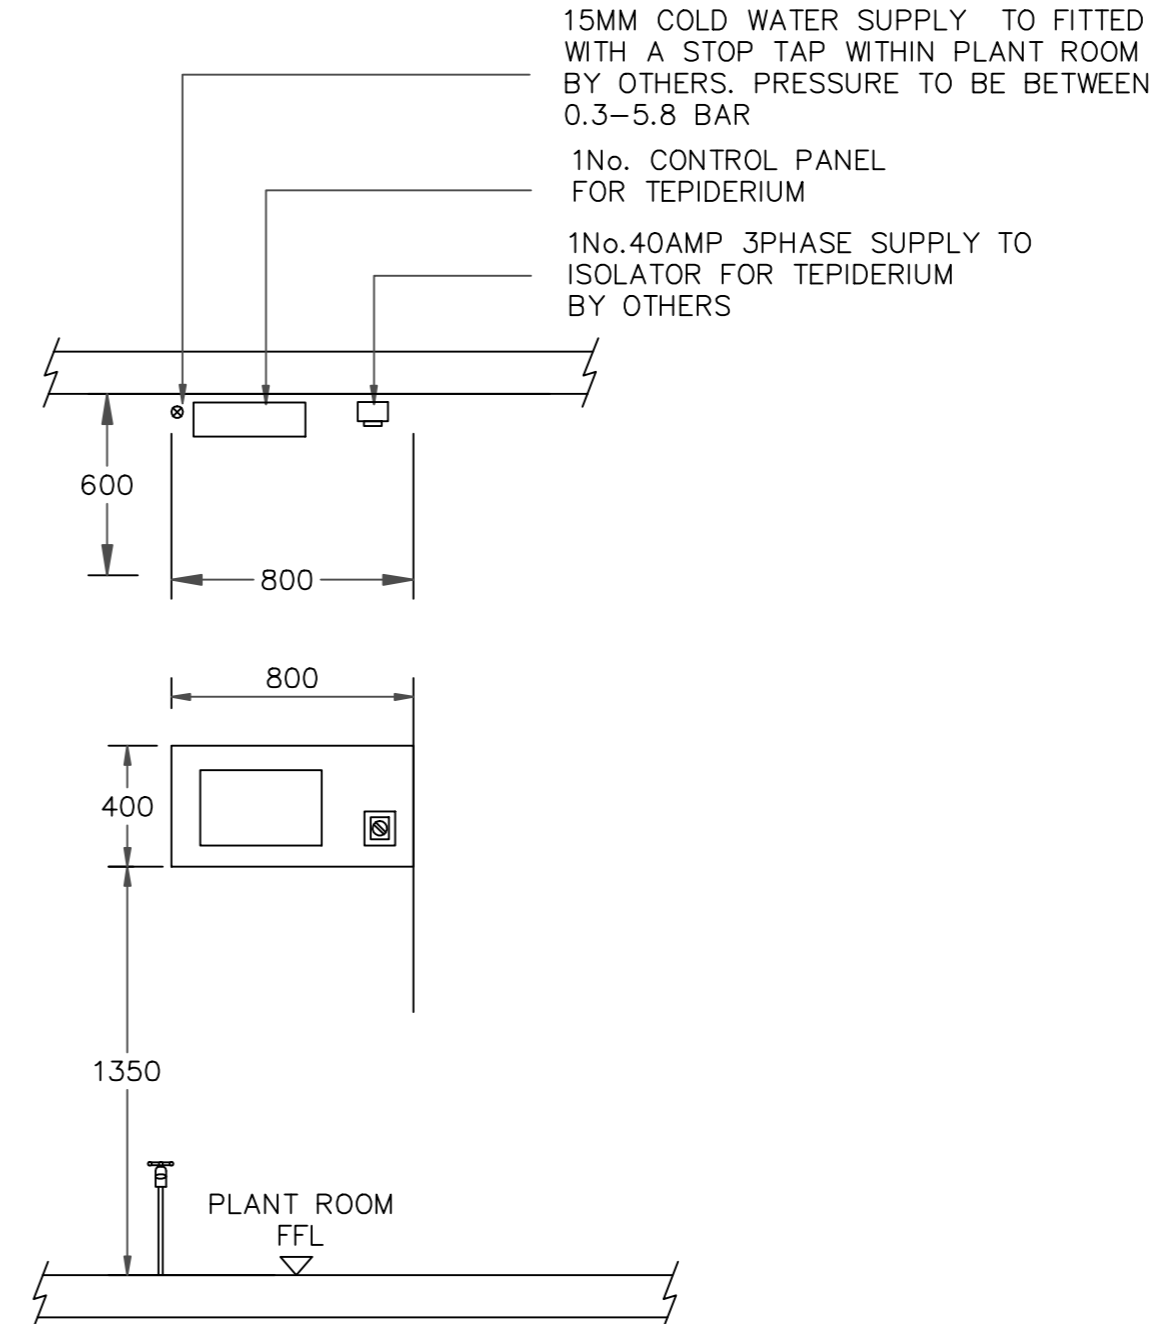


TEPIDERIUM PLANT

NOTES:

All dimensions must be checked on site and not scaled from this drawing.

This drawing is the copyright of Aachen Wellness Limited. and must not be copied, in part or in full, or the contents divulged to any third party without the written approval of Aachen Wellness Limited.

NB: A MINIMUM ALLOWANCE OF 600MM OF SEATING SPACE SHOULD BE ALLOWED FOR EACH PERSON

Rev	Date	Amendments	By
 <i>Aachen Wellness.</i>			
Project Title			
STANDARD DRAWINGS			
Drawing Title			
MATRONA TEPIDERIUM SPECIALIST			
Date		Scale	
22.07.10		1:25@A2	
Status			Drawn by
FOR COMMENT			RL
Drawing No.			Rev
08			*