


NB: 1500MM VOID ABOVE REQUIRED FOR ICE ROOM PLANT EQUIPMENT

NB: AIR CHILLER CAN BE PROVIDED AS AN OPTIONAL EXTRA

NB: ICE ROOM CAN BE CUSTOM BUILT TO ANY SHAPE. CONSTRUCTED FROM EITHER TILE BACKER BOARD OR GLASS BLOCKS

YMIR ICE ROOM PLAN

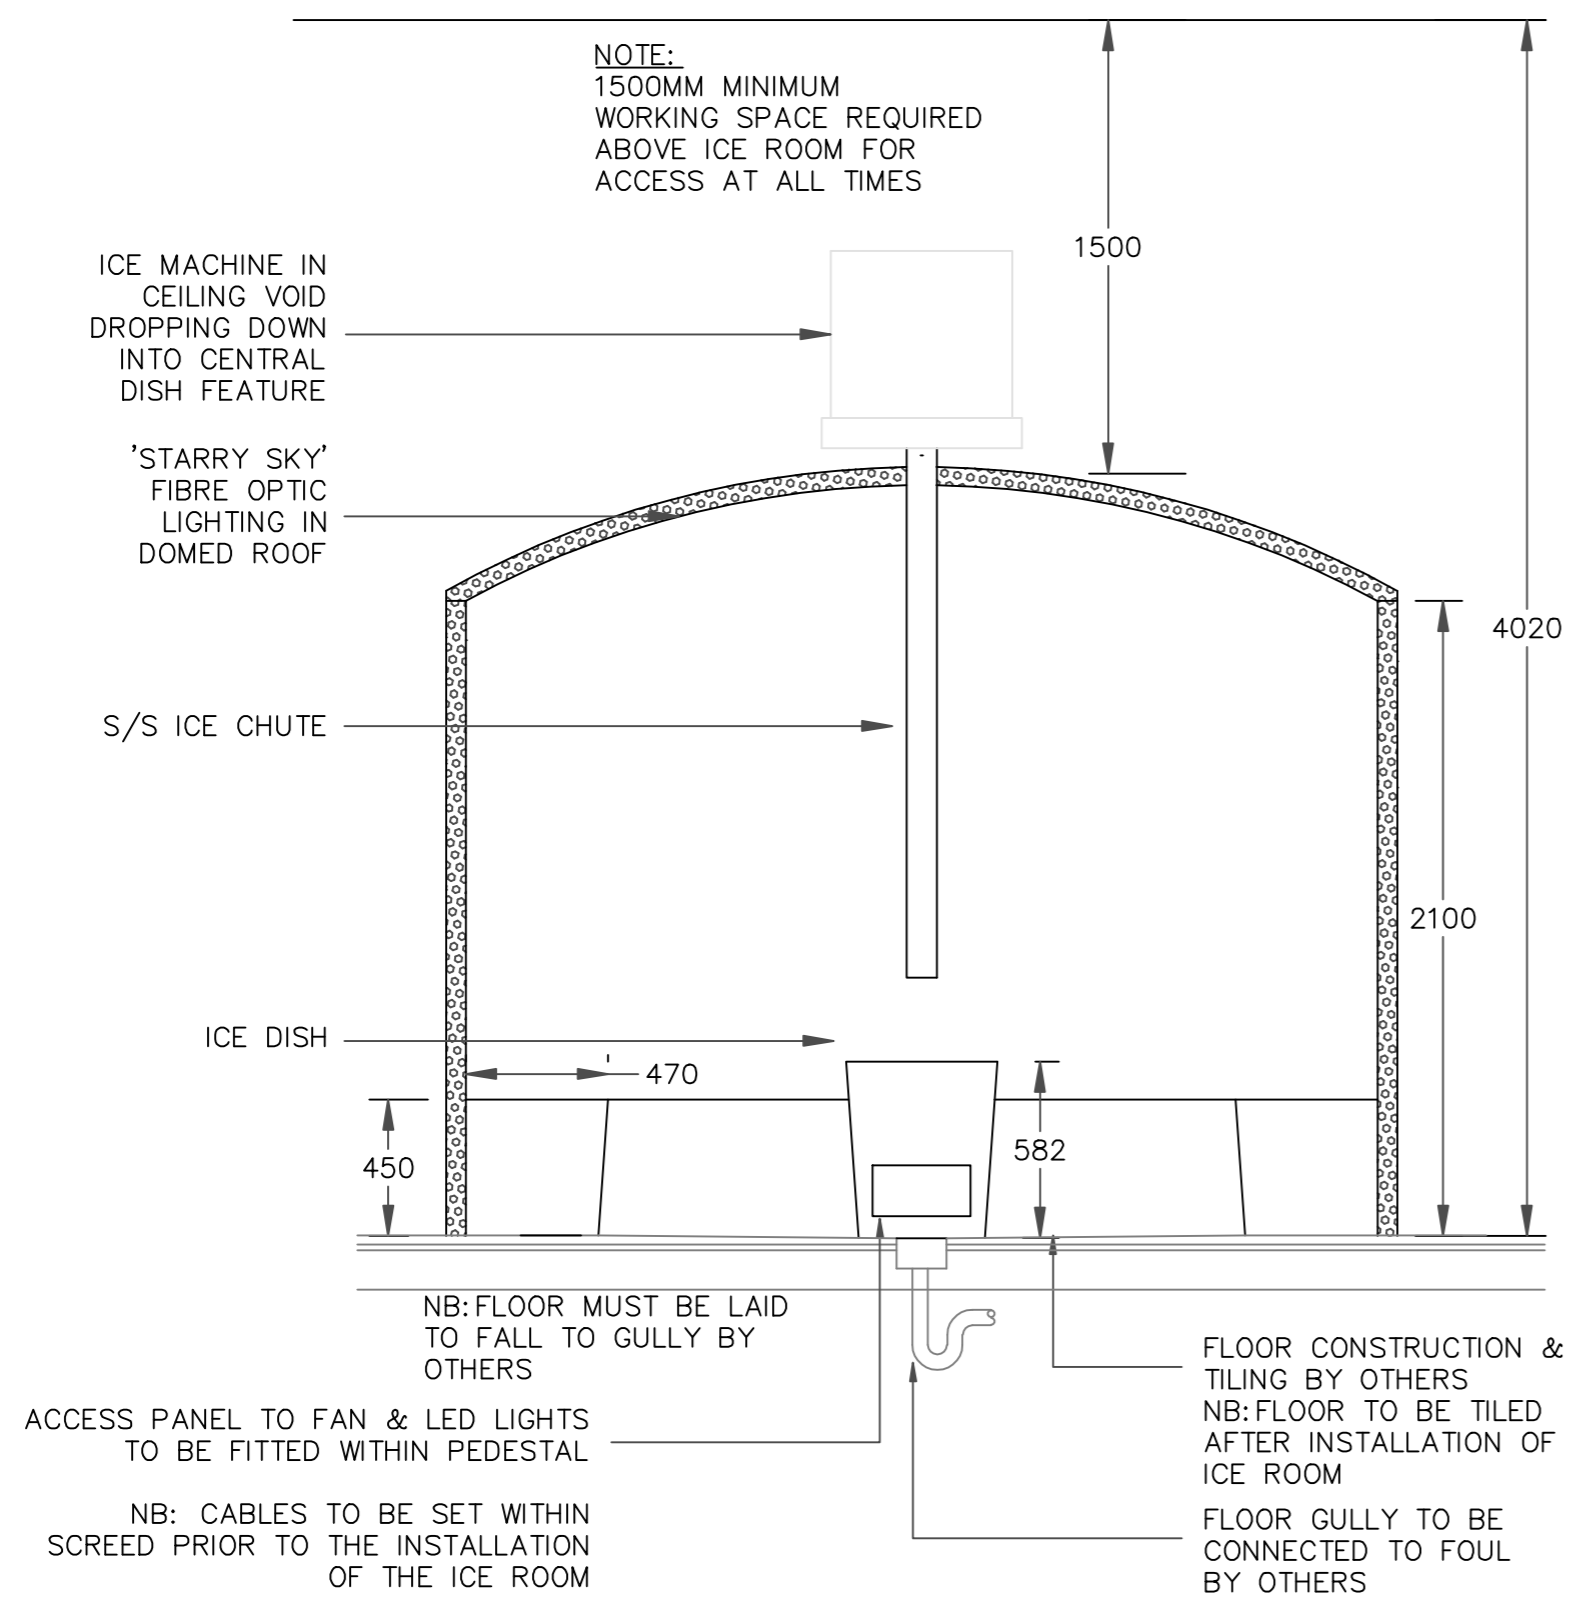

YMIR ICE ROOM SECTION

ICE ROOM SERVICE REQUIREMENTS

ICE ROOM TO BE FITTED ONTO A FLOOR WHICH IS WATER PROOF SCREDED

ICE ROOM FLOOR TO BE TILED BY OTHERS AFTER ICE ROOM HAS BEEN INSTALLED. GROUT TO BE EPOXY GROUT.

ICE ROOM FLOOR TO BE CONSTRUCTED OF IMPERVIOUS MATERIALS WITH A 1:100 FALL TO 1 NO TRAPPED 100MM GULLY UNDER ICE DISH.


1500MM VOID REQUIRED ABOVE THE ICE ROOM FOR THE ICE MAKING MACHINE.

1No. 15MM COLD WATER SUPPLY REQUIRED TO TERMINATE IN VOID ABOVE ICE ROOM BY OTHERS

1No. 15MM COLD WATER SUPPLY REQUIRED TO BE CONNECTED TO A PIPE WITHIN THE ICE ROOM WALL & SEAT TO AID COOLING, BEFORE CONTINUING TO A REGULARLY USED HEADER TANK BY OTHERS.

2 NO SINGLE PHASE SUPPLY AT 15 AMPS SUPPLIED TO AN ISOLATOR BY OTHERS. ISOLATORS TO BE WITHIN 1 METRE OF THE ICE ROOM CONTROL PANEL IN PLANT ROOM

PLEASE NOTE THAT SERVICE REQUIREMENTS ARE DEPENDANT UPON ROOM SIZE.

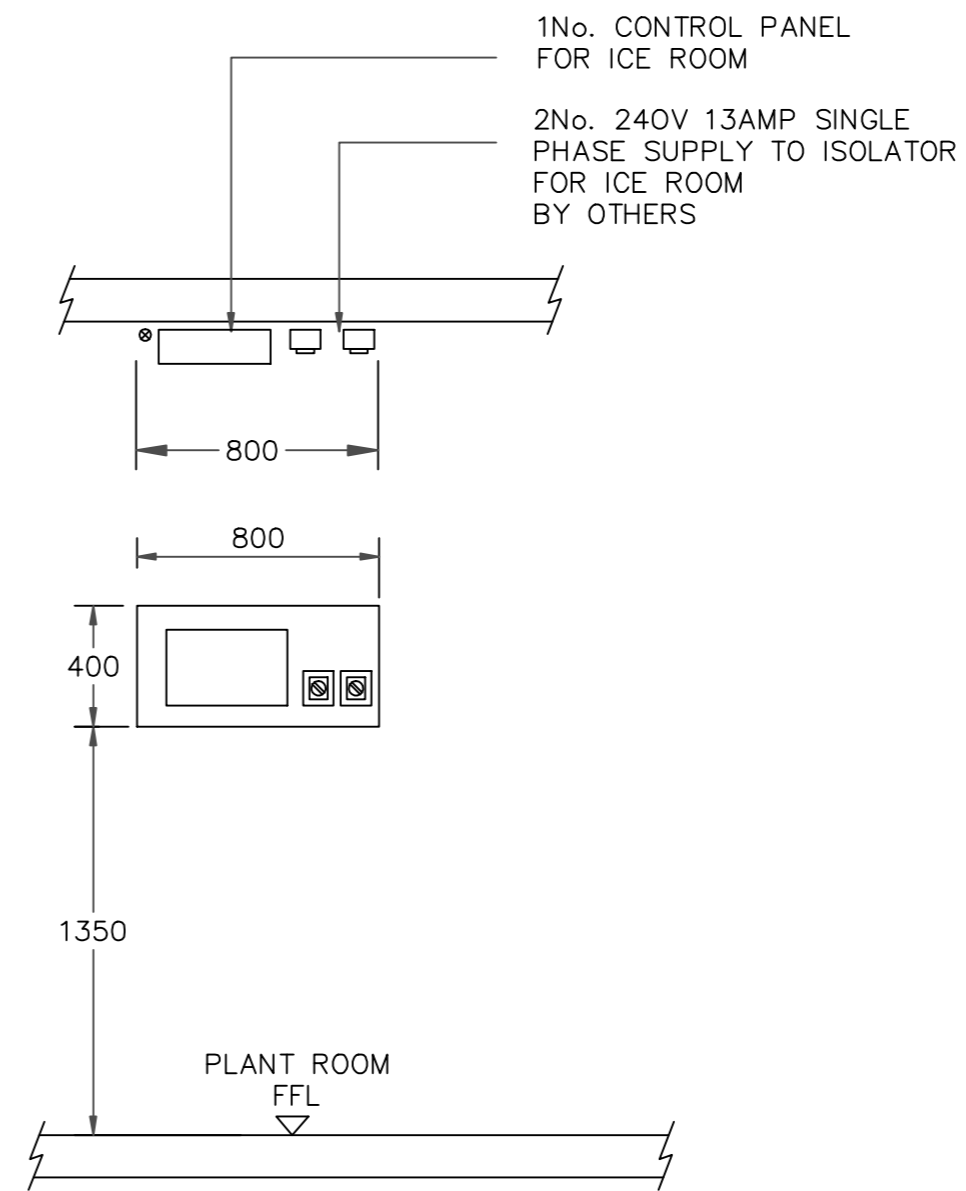

YMIR ICE ROOM PLANT

NOTES:

All dimensions must be checked on site and not scaled from this drawing.

This drawing is the copyright of Aachen Wellness Limited. and must not be copied, in part or in full, or the contents divulged to any third party without the written approval of Aachen Wellness Limited.

NB: A MINIMUM ALLOWANCE OF 600MM OF SEATING SPACE SHOULD BE ALLOWED FOR EACH PERSON

Rev	Date	Amendments	By
 Aachen Wellness.			
Project Title			
STANDARD DRAWINGS			
Drawing Title			
YMIR ICE ROOM SPECIALIST			
Date		Scale	
22.07.10		1:25@A2	
Status			Drawn by
FOR COMMENT			RL
Drawing No.			Rev
09			*