


NOTES:

All dimensions must be checked on site and not scaled from this drawing.

This drawing is the copyright of Aachen Wellness Limited. and must not be copied, in part or in full, or the contents divulged to any third party without the written approval of Aachen Wellness Limited.

NB: A MINIMUM ALLOWANCE OF 600MM OF SEATING SPACE SHOULD BE ALLOWED FOR EACH PERSON

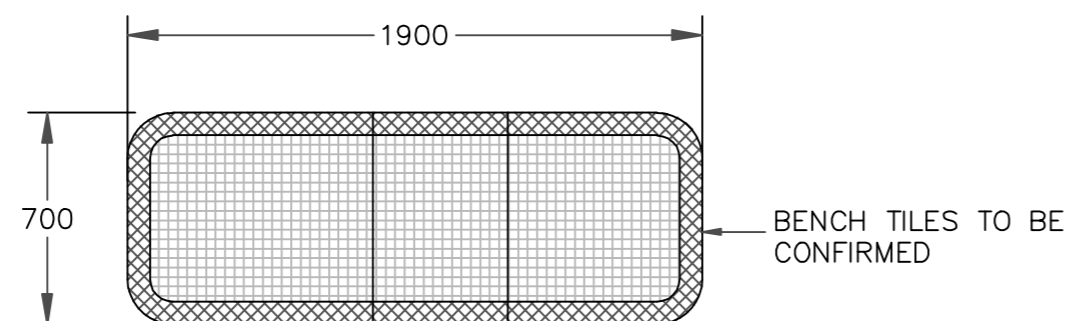


HEATED LOUNGER PLAN

HEATED LOUNGER SERVICE REQUIREMENTS

THE HEATED LOUNGER SHOULD BE MOUNTED ON A FLOOR THAT IS MADE OF A MATERIAL THAT IS IMPERVIOUS TO MOISTURE. THE FLOOR NEEDS TO BE LEVEL ROUND THE PERIMETER.


THE FLOOR TO BE TILED BY OTHERS BEFORE LOUNGER INSTALLATION. GROUT TO BE EPOXY GROUT

22MM LPHW SUPPLY 25-45°C VARIABLE WITH A 'STAT AND BYPASS BY OTHERS AT 1.2 TO 2 LITRES PER MINUTE FLOW AND RETURN REQUIRED TO A STOP TAP. APPROXIMATELY 1.5kW PER LOUNGER. LOCATION TO BE AGREED WITH M&E CONTRACTOR

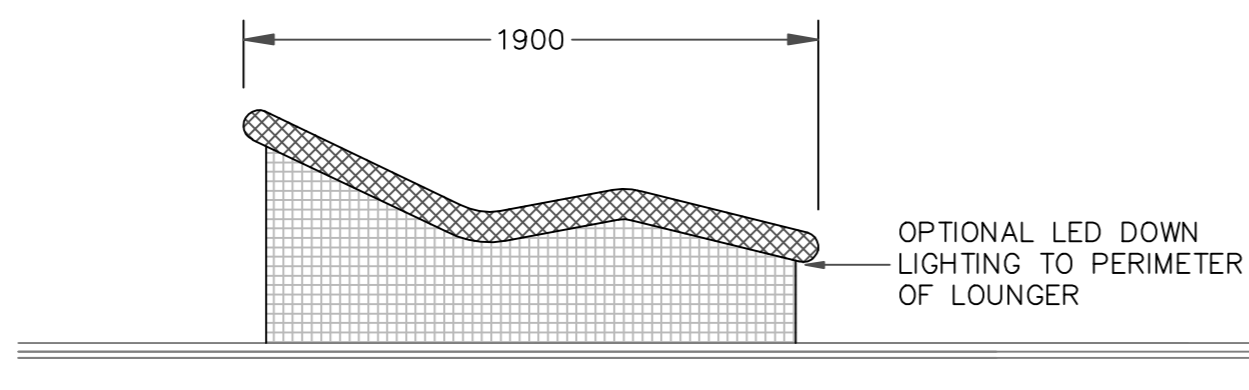

HEATED LOUNGER SECTION

Rev	Date	Amendments	By

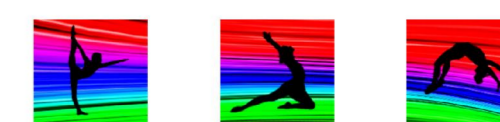

Aachen Wellness.

Project Title

STANDARD DRAWINGS

Drawing Title

**HEATED LOUNGER
STANDARD**

Date

22.07.10

Scale

1:25@A2

Status

FOR COMMENT

Drawn by

RL

Drawing No.

13

Rev

*